



ENC Testing Inc.
Geotechnical Testing and Consulting

HYDROMETER ANALYSIS (ASTM D422)

Sample: North

Job No: 961 - 1

Client: Forus Contracting Ltd.

Depth: _____


Date: 17-Nov-25

Project: R.M of Big Arm

Location: _____

Made By: LR

CK'd By: _____

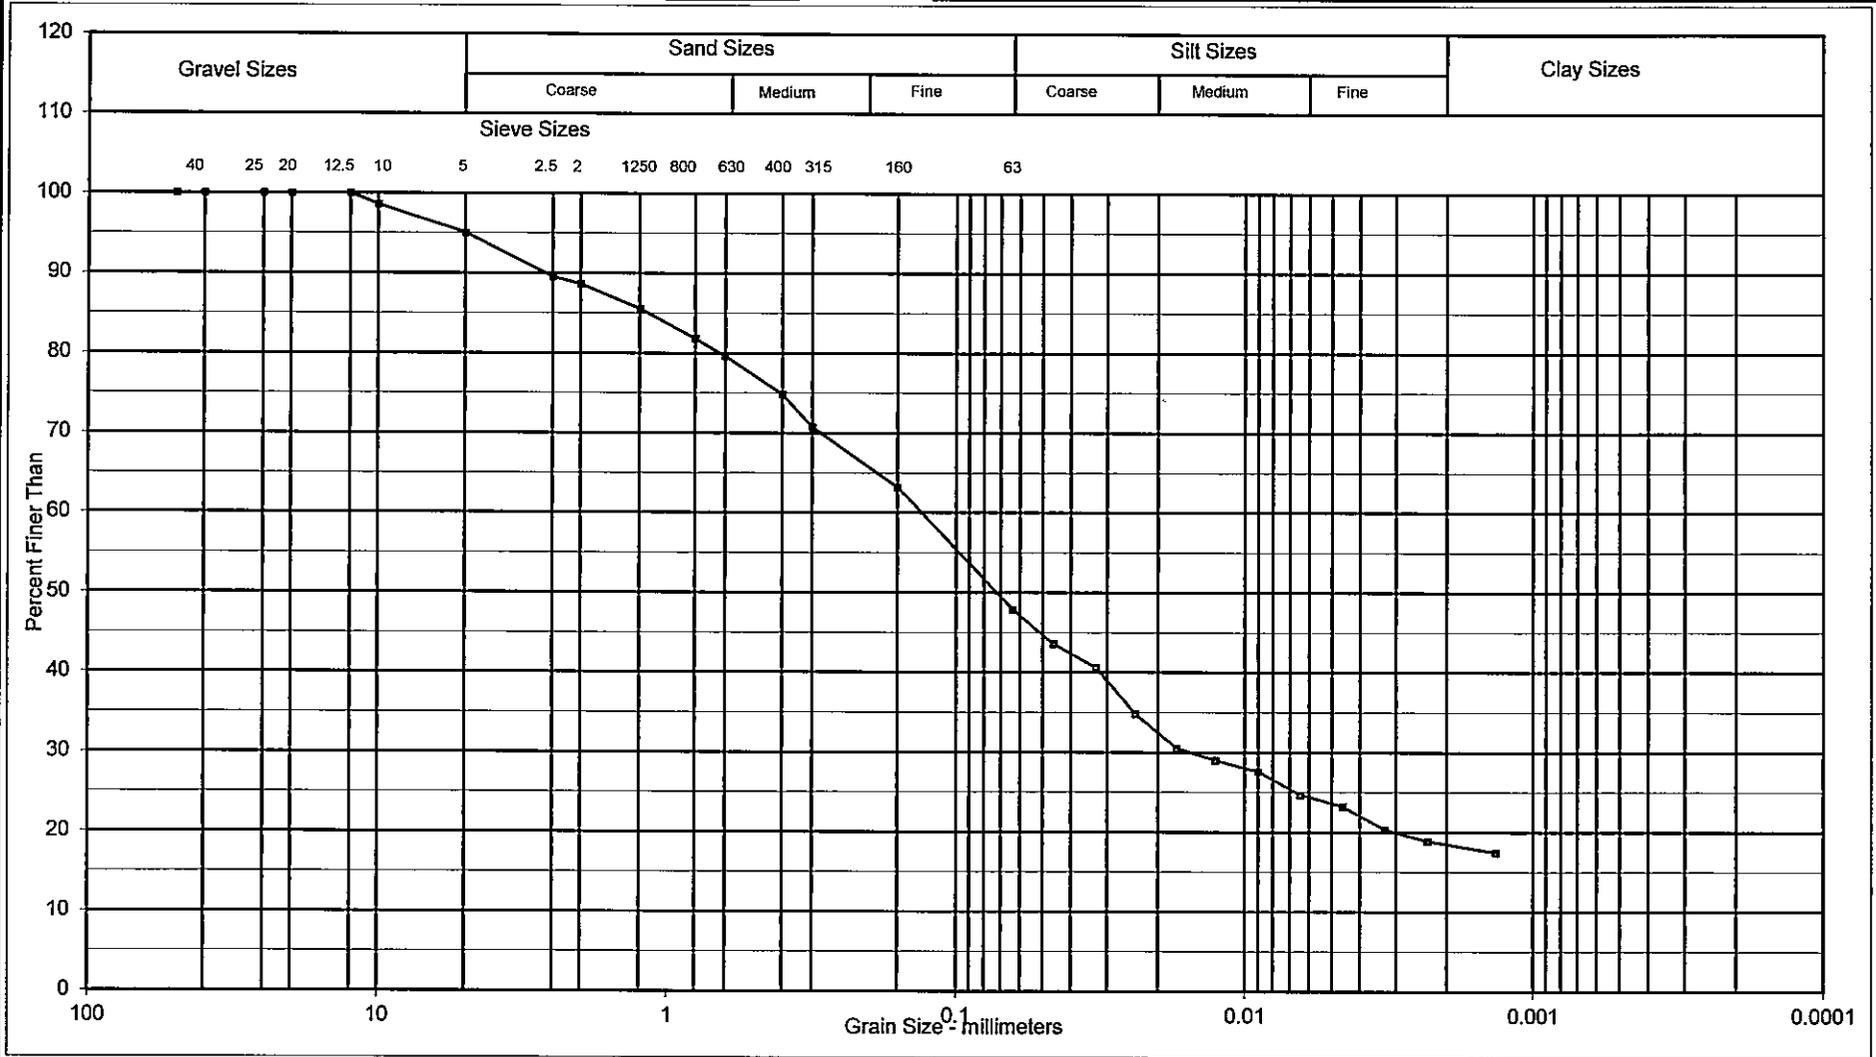

Remarks: Medium brown clay till, sandy, trace silt

Gravel=	11.4%
Sand=	40.7%
Silt=	29.5%
Clay=	18.4%



ENC Testing Inc.
Geotechnical Testing and Consulting

HYDROMETER ANALYSIS (ASTM D422)

Sample: South

Job No: 961 - 1

Client: Forus Contracting Ltd.

Depth: _____


Date: 17-Nov-25

Project: R.M of Big Arm

Location: _____

Made By: LR

Ck'd By: _____

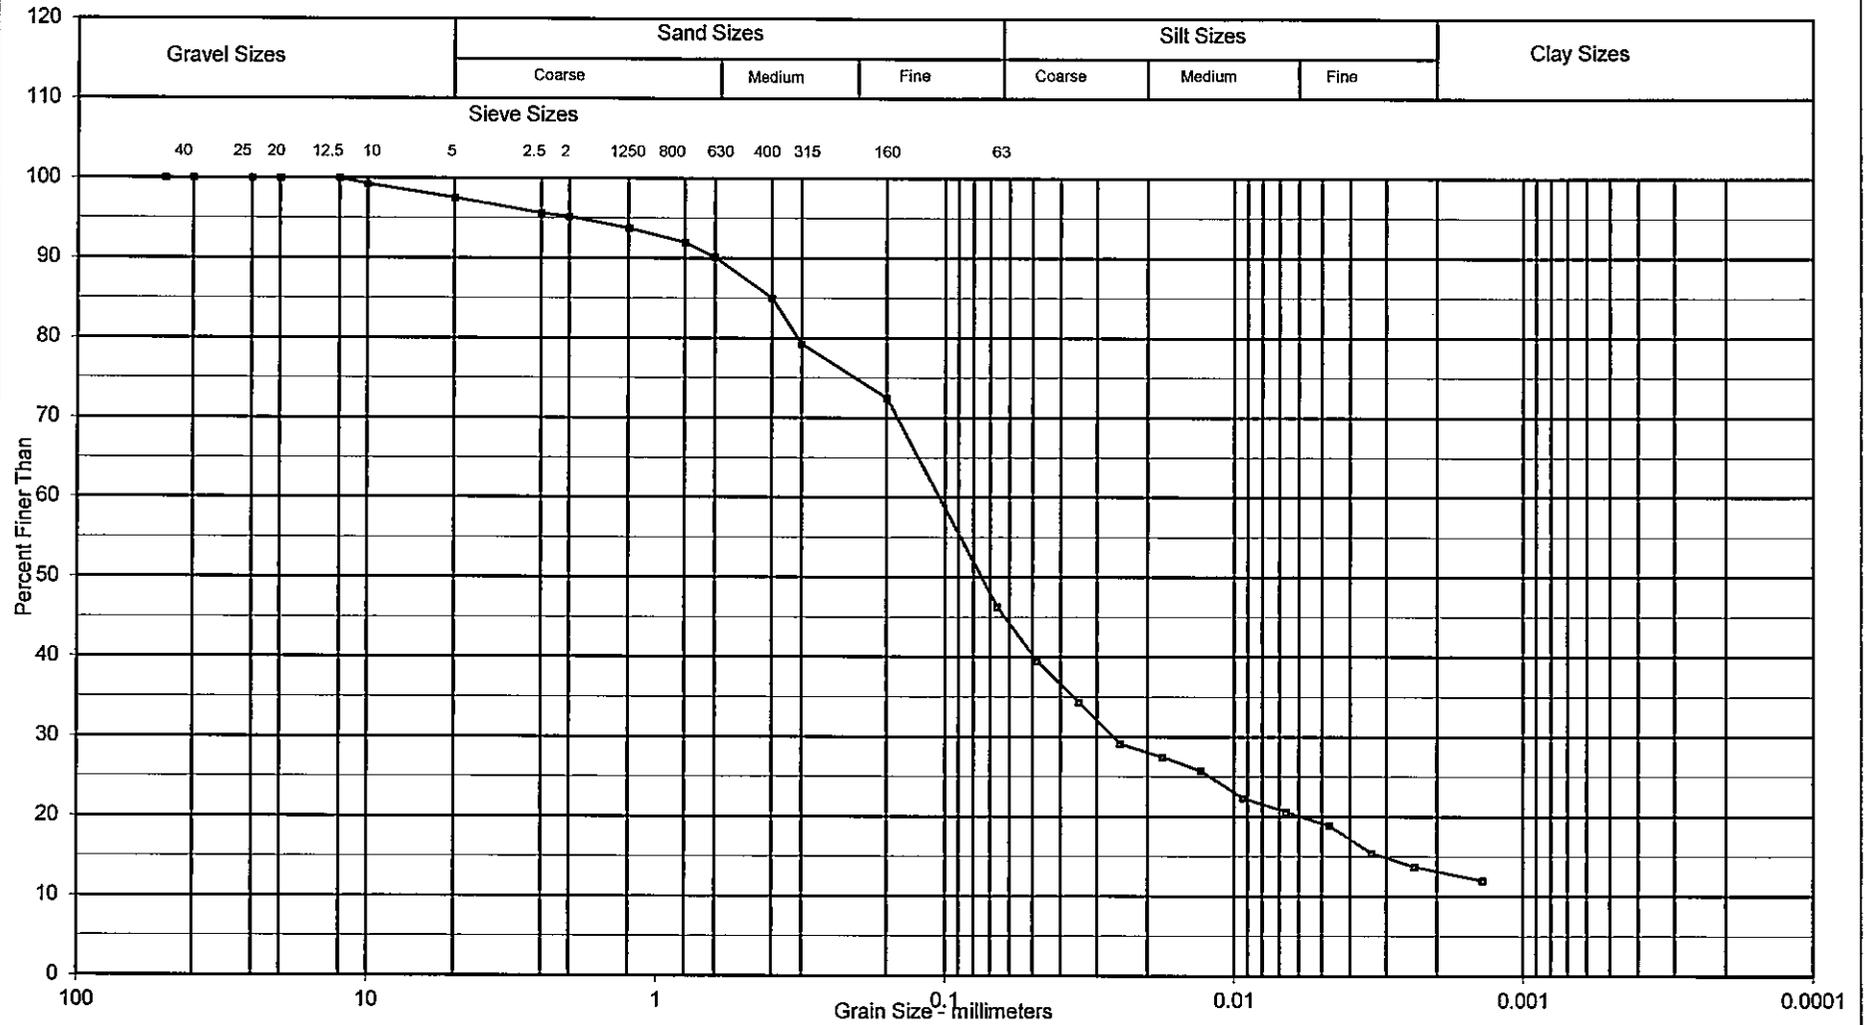

Remarks: Dark brown sand, silty, trace clay

Gravel=	4.9%
Sand=	48.8%
Silt=	33.3%
Clay=	13.0%




ENC Testing Inc.
Geotechnical Testing and Consulting

HYDROMETER ANALYSIS (ASTM D422)

Sample: Tyler's Driveway Job No: 961 - 1
 Depth: _____ Date: 17-Nov-25
 Location: _____ Made By: LR
 CK'd By: [Signature]

Client: Forus Contracting Ltd.
 Project: R.M of Big Arm

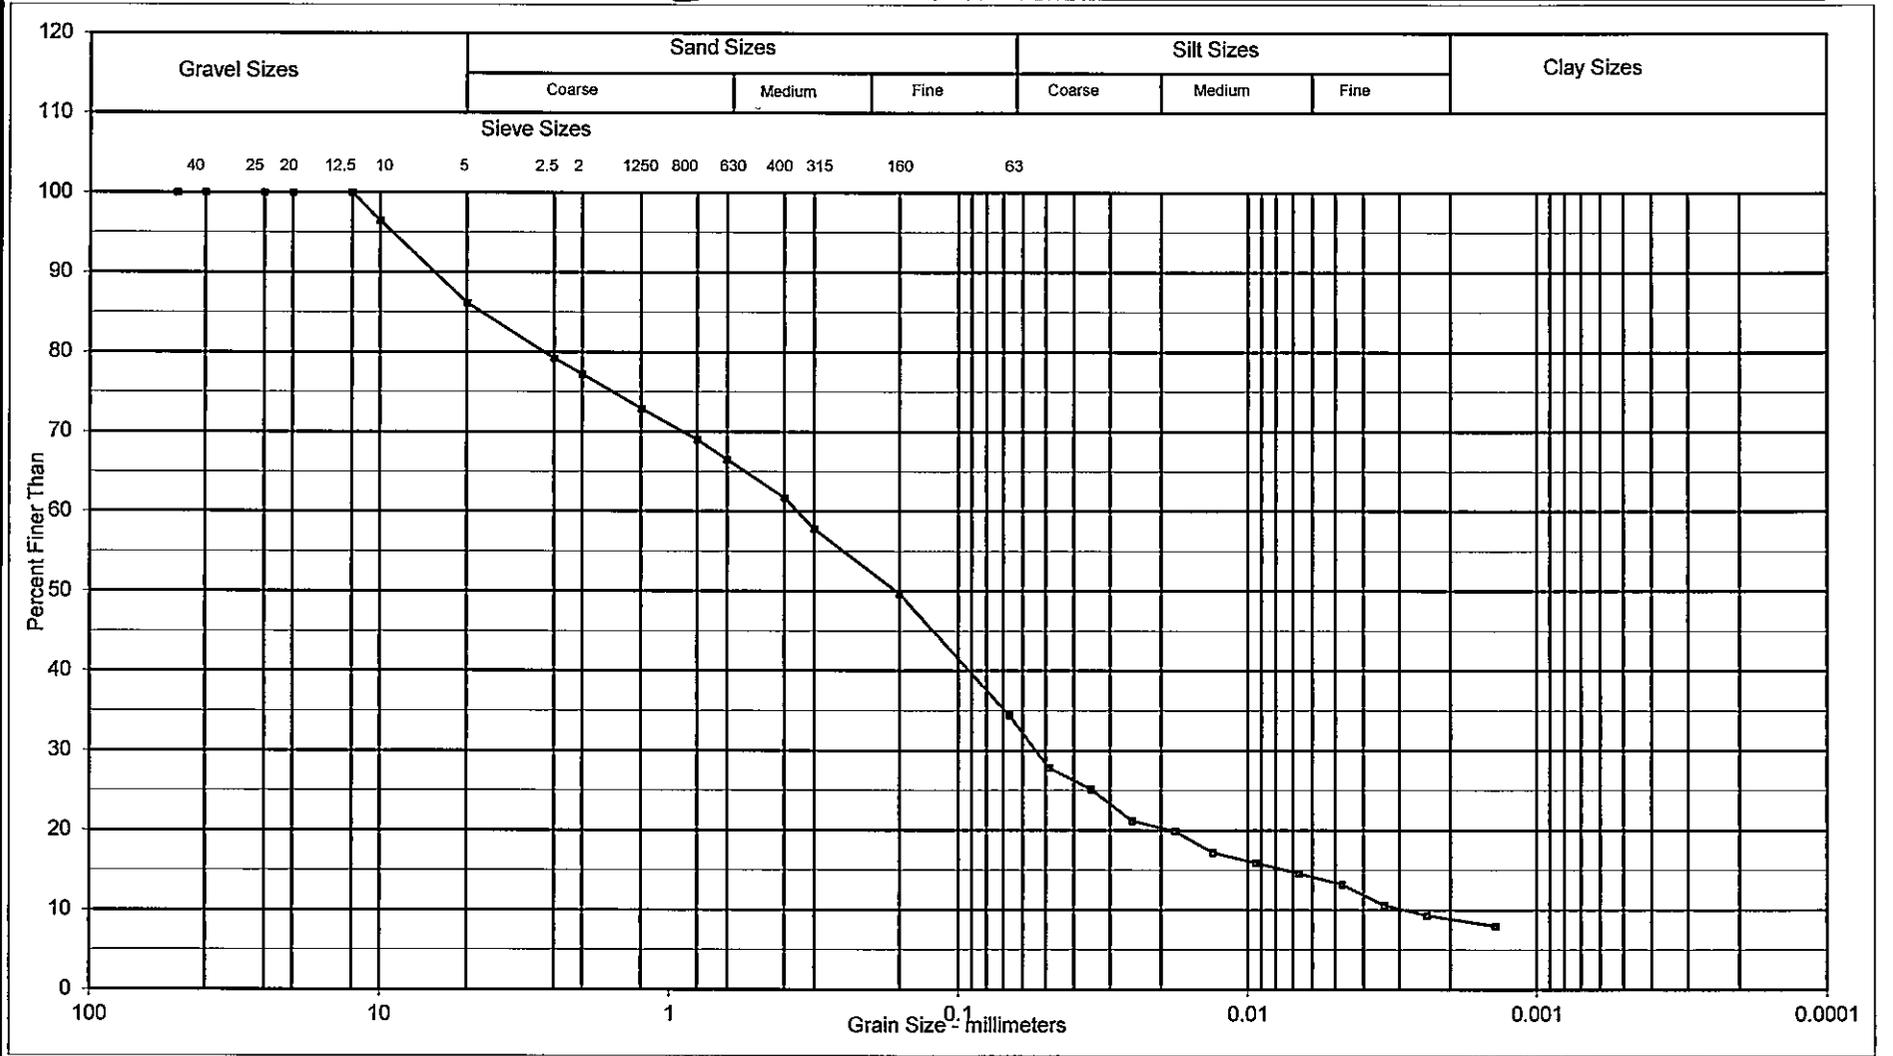

Remarks: Medium brown clay till, sandy, trace silt

Gravel=	22.8%
Sand=	42.7%
Silt=	25.8%
Clay=	8.7%